

# **Cost analysis of South African electricity generation plants**

**Ndala Yves Mulongo and Pule Kholopane**

Department of Quality and Operations Management

Faculty of Engineering and the Built Environment

University of Johannesburg, PO BOX, 524, Auckland Park, 2006, South Africa

[Ndalam@uj.ac.za](mailto:Ndalam@uj.ac.za); [Pulek@uj.ac.za](mailto:Pulek@uj.ac.za)

## **Abstract**

South Africa has got a large array of natural resources involving some of the most envied sustainable energy resources such as sunlight and wind. Despite this, the country's electricity is consistently and largely produced from fossil fuels sources. To mitigate this dependence and move towards a power supply system allowing bigger room for flexibility without economically degrading power cuts or electricity buy-backs from intensive energy consumers, the electricity utility decided to step up renewable energy sources. All of this came at a cost. Therefore, this paper aimed at offering policymakers a more accurate picture of the tradeoffs involved in decision affecting the electricity sector. To achieve this objective, various costs analyses were conducted including sensitive ones of the cost of electricity from conventional generation sources with the cost of electricity from renewable generation sources. A conclusion was drawn up in three parts noting that although renewable technologies are expensive, they should be given more weight because they are inexhaustible, they guarantee safety to the environment, and they do not emit greenhouse gases into the environment.

## **Keywords**

Fossil fuels, renewable energy sources, cost of generating electricity, South Africa.

## **I. Introduction**

Electricity is assuredly the master key for energy source across the world. The implication is that the world has been modernized due to the use of electricity. All the facilities and equipment that developed countries rely upon and developing countries seek, from lighting to the most sophisticated electronic devices, require electricity to operate. Electricity is a product that is hard to store because it is the most fleeting among all types of energy. Therefore, it must be consumed as soon as it is generated [29]. These two characteristics (most fleeting and hard to store) make electricity both the most important and one of the most difficult product to understand economically. Due to its magnitude and economic importance, the electricity sector often needs significant investments to increase its power capacity in order to meet demand from consumers. Therefore, any lack or shortage of electricity does serious damage to the economics' activities of a country and its people [14].

Electricity plays a crucial role in the South African economy. Without a doubt, electricity is of fundamental significance in any economy. Since electrical energy is an important key input to the production process that transforms inputs into products and services. It is also significant to the daily workings of South African households. Therefore, power policy and management practices in the electricity sector may have important impact on the macro economy as well as on individual South African households. Thus, understanding the costs of saving energy is important for assessing existing energy policy and for managing the development of future energy policy [37]. An important contribution of the research presented in this paper is the evaluation of the costs of saving energy. Because in the past and current most of studies have focused on evaluating the costs of generating electricity rather than those of saving energy [38]. The South African economy is counted among the developed and emerging economies across the globe. South Africa is rich in coal, and consequently has an infrastructure to harness the energy it has in her domestic resources stock. In the other world, South Africa is counted among the countries that deploy coal at large-scale. For example, Burnard, & Bhattacharya [3] report that, the share of coal in producing electricity locally was approximately 93% in 2011 and coal counted for nearly 70% of total South African primary energy supply. This may

not be unexpected knowing that South African coal export prices range amongst the lowest in the world. South Africa is the most progressive economy across Africa. Griffin [14] States that, the healthier an environment becomes, the more significance is given to clean energy supply and to energy security matters. Although competitive companies such as mining, automotive, agriculture, food processing, manufacturing and a thriving service area has emerged in South Africa, both energy security and clean energy supply still represent a big obstacle for the country. External impacts from air pollution, usage of insufficient water facilities and carbon dioxide emissions from a considerable burning of hydrocarbons are a huge issue, especially in the Mpumalanga region, where coal power stations with a capacity of 30 GW are installed [10].

The South African government has acknowledged the necessity for a clean and reliable energy system for its environment and economy. In 2003, the Department of Minerals and Energy (DME), predecessor of today's Department of Energy (DoE), has made an agenda for future energy planning. This agenda was called the Integrated Energy Plan (IEP) and includes South Africa's main principle files for energy planning. The Integrated Resource Plan (IRP) is placed in the IEP and controls the production of electricity and transmission capacity planning. It is regularly re-viewed, in accordance with the new technological and cost developments [7]. In addition, to environmental deterioration, energy supply problems are considered as issues, which often take place. Generally, power outages occur during the period of peak demand and both generation and transmission systems are quite regularly under their utmost strain [10], [25].

## **II. Literature review**

### **II 1. South African electricity sector**

Griffin [14] reports that investment within the electricity sector involves the following components:

- Generation,
- Transmission,
- Customer, and
- Electricity market

### **II.2. Generation**

Electricity generation plays an important role in the betterment of human life. Besides its social benefits, electricity is also a driving factor for the economy. Its deployment varies from communication, transportation to generation. Thus, electricity as a public product should be available at any time, mostly everywhere and must be deployed for a wide range of applications. For this reason, the idea of availability is considered as another significant aspect in a non-monetary assessment of numerous generation technologies. As electrical energy may not be economically supplied on a large-scale, it must be generated at the certain period and within the same quantity, which is practically demanded and must be conveyed instantaneously from power plant to the consumer through transmission lines. Due to these important features, the electrical energy supply system should be shaped for the utmost anticipated demand [54]. In South Africa, the production of electricity is dominated by Eskom. Thus, Eskom is the main South African electricity producer and there is no wholesale electricity market. In accordance with Eberhard [44] the generation and supply (retail) factors of the power business are good for competition, whilst transmission and distribution are considered as natural monopolies. The major electricity source in South Africa is coal. The generation technology mix is not very diversified in the South African industry.

In 2012, power generation kept on being much depended on coal, even if IPPs participated in power production with more than 4.1 TWh. Because of strains from the demand side, the mothballed coal power plants Komati, Camden and Grootvlei had to be re-commissioned. Consequently, a massive 92% of Eskom's 2012 electricity output of 237.3 TWh was produced in coal power plants with a total nominal capacity of 37,745 MW. For the remaining 8% of electricity produced, nuclear power amounted to 5.7%, whilst pumped-storage hydro power contributed 2% to the electricity supply. Other technologies that contributed to the remainder were OCGT (fired with diesel oil) and wind, whilst PV and biomass were only used on a non-commercial scale [50]. It should be noted that, the South African government has developed the Integrated Resource Plan (IRP) as a long-term policy document for the future electricity planning, which is expected to run from 2010 until 2030. The IRP was presented by the Department of Energy (DoE) in 2010 with the goal of identifying needed investments for the power supply sector that are most beneficial to South African interest, given technical, economic and environmental issues [43]. Therefore, the IRP provides a probable composition

of South African energy mix to meet the demand of 454 TWh in 2030. As input factors such as technology, demand, financial conditions, electricity prices or emission costs could be subject to change in the future, the IRP will need to be revised every two years, although an update has not yet been released since the end of 2012 [43].

### **II.3. Transmission**

The legal basis for regulation of grid management and operation is provided by The Energy Act [48] “The goals are to direct monopoly functions to safeguard end-users’ rights, and to guarantee effective operations of the grid” [48]. Electricity generation and use are linked together through the electricity grid that consists of power lines, cables, transformers and numerous other elements [48]. According to Eskom [46] the South African transmission grid includes nearly 31 107km of transmission lines and 160 substations with a total of 139 610MVA of installed transformer capacity. The distribution network transmit energy from the high-voltage transmission network to end-users, comprising municipalities, which control their own distribution networks, via infrastructure consisting of 48 278km of distribution lines, 281 510km of reticulation lines and 7 436km of underground cables, as well as 99 880MVA of installed transformer capacity [46]. Important lengths of new transmission lines and associated substations and substation facilities are being added to the system. These extra additions are mostly because of the main 765 kV network reinforcements needed for the supply within the provinces of Western Cape and KwaZulu-Natal. The introduction of Medupi power plant within the emerging Limpopo West Power Pool also needs important lengths of transmission line, since it is a long distance away from the main load centres [46]. The high-voltage direct current (HVDC) lines/system needed for another generation improvements within the region of Limpopo are as well not considered, because they shall simply be needed in the coming decade [46].

### **II.4. Customer**

Customers or consumers are described as people who purchase electrical power for their own use. Generally, small and private users purchase electrical power through an intermediary such as a trading industry or a distribution utility, whilst bigger consumers usually purchase directly within the wholesale market [40]. Consumers are free to select which electricity producer they wish to deploy. The total electricity price for consumers consists of the wholesale price of electricity, network charges and taxes. The charges faced by households are significantly higher than industrial prices in accordance with [28]; this is mostly a reflection of the extra costs of distribution charges. Residential customers may select among different kind of contracts for electrical energy. The most common is based on a variable price, another type is based on fixed price contracts and the third type of contract is based on the spot price movements with a fixed retailer margin. Industrial customers, generally in smelting industry, usually have long-term contracts. The sector also meets its requirements from its own power plants’ long-term commercial contracts and purchases on the spot market [52].

### **II.5. Important parameters within the electricity sector**

#### ***II.5.1. Security of energy supply***

One can define security of energy supply as an ongoing availability of electricity, in sufficient amounts and at acceptable price [38]. Supply security has physical, economic, social and environmental sides or risks in accordance with Costantini [40] physical interruption may be caused when a power source is depleted or generation is turned down, either for a short or long period [40]. This system failure can take place because of weather conditions, absence of capital investment or more often poor conditions of the power system [45]. Economic interruption is caused when there is unpredictable changes in the worldwide markets within the price of energy goods [40]. Change may be caused by for instance a threat of a physical interruption of equipment, or prediction of such interruption, and absence of investment or inadequate contracting [45]. Lack of stability of energy equipment can also cause important social interruption. This is because of the demand and dependability for energy within nowadays’ world, where instability has a big influence over both private and commercial interest [40]. The last parameter in the definition, environmental interruption, is concerned with the damage to the ecosystems caused by the energy chain. One may further distinguish between short and long run energy security. The first one is concerned with interruption and alleviation of these or rises in prices. Whereas long-run security considers the energy system and as such the reasons of interruptions together with the availability of adequate energy to enable stable and economic development [40].

#### ***II.5.2. Consequences of supply interruptions***

Costantini [40] argue that there is an agreement within the literature that the costs of supply interruption go beyond the economic measures of national accounts. The reason is that “energy consumption flows through daily life in such a continuous and ever-present manner, which is why, it is hard to make a difference between all the short- and long-run negative impacts”. Supply interruption may be divided into either short-, medium or long run, where the following results would generally be highest for long-interruptions, but less probable to take place [40]. De Nooij [42] have tried to determine the causes of interruptions and the values that society places on these. They state that there is no agreement on evaluating supply interruptions, and one significant constraint is that the causes are different depending on the type of situation [42].

### **II.5.3. Measuring supply security**

Today, a lot of people see supply security of power to be very important, but the value that society places on it is not an important parameter. Generally, this information can be derived from a market, even though there is no market in which power-supply outages are traded [42]. As developments within supply security would come at a cost, these costs should inevitably be paid by the society in accordance with Damigos [41] “either by increasing energy bills or through public financing”. These investments should thus be based on cost analysis. In the lack of a market to determine the costs of supply outages, economists and academics have developed several methods for calculating the impacts of a supply outages [26], [39].

## **II.6. Electricity Market**

In 2010, South Africa was the largest African market in terms of electricity supply. In all, the country generated nearly 39.8% of electricity use across the continent that ranked at the first position, followed by Egypt and Algeria [50]. During Eskom’s financial year 2012, the overall electrical energy supply accounted for up to 254.4 TWh, with an important share producing from Eskom’s own power generation plants and minor shares generated from electricity imports and IPP production. Internal deploy for wheeling, pumping and internal sales amounted to 7.6 TWh. A further 22 TWh were lost in the process of transmission and distribution and in the end 224.8 TWh were available for market to meet the electricity demand. Despite a huge demand during the past years, physically Eskom was not capable to meet the South African entire electricity demand with the 224.8 TWh it delivered in 2012. Lazenby [53] argues that the supply/demand gap for 2012 was nearly 6-9 TWh. However, as initiatives to cut down the demand were developed, it is really very hard to come up with a significant figure concerning the supply outages in 2012. The situation was mainly problematic during evening peak demand hours and it was indicated that Eskom was not able to meet the weekly peak demand from its own generation portfolio on 43 out of 52 weeks in 2012 [47]. To shadow the gap, electrical energy had to be imported through the SAPP.

Furthermore, programmes to save energy were developed under the Integrated Demand Management Programme (IDM), in which Eskom had adopted components from Brazil that coped with a similar situation in 2001. Programmes involved for example the “49-million campaign” targeted at the private sector to conserve electricity, and contracts with industries from the Energy Intensive User Group (EIUG), which enabled for load shifting [47] depicts that these two sectors amounted to the largest share of electricity demand in 2012, followed by the commercial sector which was as important as the mining sector.

Future electricity demand as designed in the IRP scenario is expected to increase on average by 2.8 %7 per year until 2030. But, there is discordance between economists concerning the approaches deployed in the forecast and numerous authors have illustrated several option projections. For example, Amusa [37] state that several sectors would respond differently to price changes in the future because of their differing price elasticity of demand. In their decomposition analysis, Inglesi-Lotz and Blignaut [51] notice that extra elements with important impact over the South African future electricity demand were altered in generating outputs, energy efficiency programmes and structural variation. Ziramba [55] states that electricity demand from the South African residential sector will not be influenced much by electricity price variation and utilization will not grow considerably with higher revenues because of his low estimates on price and revenue elasticity of 0.011 and 0.33. By now it should have become clear to the reader that present generation capacity is not sufficient to meet the South African electricity demand. Investments into capacity expansion become important and certain programmes are being built [55].

## **III. Methods**

The costs of producing electricity are generally evaluated according to the LCOE approach. Because it shows the minimum marketing price of the electricity generated through a generating technology, assuming constant within real currency units, which can be needed to ensure all operating costs, interest and primary reimbursement obligations on debt, taxes and offering the investors an acceptable market return for the assumed risk. LCOE is estimated as the actual cost of the electrical energy, which makes the present worth of the returns earning from the selling of the electrical energy equivalent to the present worth of all costs met throughout the plant life-cycle. LCOE is an essential key that aims at offering the break-even of sale price and it enables the costs comparison between various electricity generating technologies. Additionally, LCOE plays an important role in the context of a free market, therefore contributing to the incorporation of market uncertainties and risks in the worth of the cost of capital cast-off to discount cash-flows. LCOE can also be defined as an indicator of the cost incurred to producing electrical energy. It should be noted that LCOE does not consider the costs associated with transmission and distribution of electricity. According to [1], [2], [4], [5], [9], [16], [17], [19], [21], and [26] state that the Levelised Cost of Electricity (LCOE) is an important tool for an economic assessment of various electricity generation technologies and it is the most consulted method in electricity sector when investment and planning decisions are to be made [16], [17], [21], and [28]. Furthermore, presently it represents the most transparent approach being used for power planning and policy development [19]. The reason of this methodology being the most used is because it allows cost comparison of several forms of electricity generation, which differ from physical principles, fuel types, and their lifespan [22], [11], [6], and [26].

When calculating the LCOE of a power plant, all discounted direct plant costs over the lifespan of the plant are divided by the discounted sum of the electricity that it would produce over its lifespan [15], [17], and [31]. In the context of financial, LCOE may also be defined as the constant level of inflows important per year to recover all outflows over the lifespan of a power plant [30], [27]. In the standard method, these outflows involve capital costs, Operation & Maintenance costs (O&M), and fuel costs. In the end, the calculation will enable a cost comparison among various alternatives over a constant unit cost basis; in this study ZAR/MWh will be used. Practically, there are two methods that can be used to determine LCOE of a power plant. It should also be noted that LCOE may be addressed within real or nominal dollars' way. When addressing LCOE in real dollar way, the effects of inflation are removed. However, in nominal dollar way the effect of inflation is considered [4], [5], [9], [26].

### **III.1. Keys input to calculate LCOE**

Typically, the calculations of LCOE of a power plant consider three cost components, which are added up.

- Capital cost,
- Operation and Maintenance (O&M) cost, and
- Fuel cost

In the following lines, these three cost factors will separately be explored and then mixed into a complete LCOE formula.

#### **III.1.1. Capital cost**

Capital cost is an important key for calculating LCOE of a power plant, and it is generally based on the Plant costs ( $C_p$ ) that are described as the costs set up to build a power plant. Generally, for such analysis, the idea of overnight costs is considered, which has been defined by defined by Klein [22], EUSUSTEL [11], and Jason [20] as the costs that incurred for the construction of a power plant immediately, and it does not consider any assumptions upon interest expenses that happen during the construction period. Often, such data is designed based on currency per unit of capacity. As all costs must be levelized over a unit of electricity produce, e.g. in ZAR/MWh. According to Daniel [5], and Guzmán [16] plant costs should be divided by the amount of electricity produce within a year. This is given by the 8760 that is the number of hours of one year (h), which are multi-plyed by the total size of the plant (C) and the capacity factor of the plant (Cf) stating the percentage of the time the power plant produces electricity.

For example, a power plant that has a rated capacity of 4 800 MW, when operates with an 85% capacity factor, it will generate 35 740 800 MWh per year. It is important to notice that no power plant can operate at capacity factor of 100%. Since, regular maintenance should be done and over time some components will be replaced, and the maintenance process will require the plant to stop [29], [20]. So far, this illustration is for capital cost per unit of power produce during one year. As matter of fact, a power plant runs over decades. That is why a Capital Recovery Factor

(CRF) must be taken into consideration. Leland and Anthony [24] describe CRF as the equivalent annual amount that the asset, process, or system should earn each year just to re-cover the initial investment at a specified discount rate over its expected life. The CRF thus converts a flow of annual payments over the lifespan of the plant into a present value. It depends on the discount rate (d) applied to the project and plant operation time (t). according to [22], [26] [19], [11], [33], [2], [9], and [4] capital cost should be calculated as presented in the equation (1) below:

$$\text{Capital cost per MWh} = \left( \frac{(C_p \times C) \times \text{CRF}}{\text{Annual electricity produce}} \right) \quad (1)$$

$$\text{CRF} = \frac{d(1+d)^t}{(1+d)^t - 1} \quad (2)$$

$$\text{Annual electricity produce} = C \times C_f \times h \quad (3)$$

Where :

- $C_p$  : is the Plant costs
- CRF: is the Capital Recovery Factor
- $d$  : is the discount rate
- $t$  : is the lifespan of the plant
- $C$  : is the rated capacity of the plant
- $C_f$  : is the capacity factor of the plant
- $h$  : is the number of hours within a year

### **III.1.2. Operation and Maintenance (O&M) costs**

O&M costs are the costs that incurred for the operation of a power plant and generally are expressed in terms of fixed ( $C_{fom}$ ) or variable ( $C_{vom}$ ). Fixed O&M costs, these are the costs that do not depend on the generated amount of electricity [22], [19], and [11]. Generally, they are set up for the things like loan payment, required maintenance, site security and staff [27], [28]. Like the plant costs the fixed O&M costs are as well divided by annual electricity produce to determine how much of them take place during one year of production. Whilst, Variable O&M costs depend on the generated amount of electricity, these costs are set up for the things like fuel costs, additional staffing, and additional maintenance. According to [26]; [19]; [26]; [36]; [33]; [12]; [13]; and [32] the O&M costs equation should be computed as presented in the equation (4) below.

$$\text{O\&M costs per MWh} = \left( \frac{C_{fom} \times C}{\text{Annual electricity produce}} + C_{vom} \right) \quad (4)$$

Where:

- $C_{fom}$  : is the fixed operation and maintenance costs
- $C_{vom}$  : is the variable operation and maintenance costs
- $C$  : is the rated capacity of the plant

### **III.1.3. Fuel costs**

Fuel cost is the cost of fuel, most often designed based on currency per megawatt-hour. For a thermal power plant, it is the heat rate (Btu/kWh) multiplied by the cost of the fuel (ZAR/MMBtu). This involves upfront fuel costs, and the on-line operating fuel usage (Klein, 2009). Allowance is made in the calculation for the degradation of a power plant's heat rate over time. Fuel cost are not considered for renewable energy. [12], [13], [9], [17], [21], [26] and [36] all describe fuel cost like the equation (5) address below:

$$\text{Fuel costs per MWh} = (\text{fuel price} \times \text{heat rate of the plant}) \quad (5)$$

When we include all cost components, the full LCOE formula is then:

$$\text{LCOE per MWh} = \text{Capital cost} + \text{O\&M cost} + \text{fuel costs} \quad (6)$$

It should be noted LCOE may be addressed within in real or nominal dollars' way. When addressing LCOE in real dollar way the effects of inflation are removed. However, in nominal dollar way the effect of inflation is considered [6] and [21]. In this study, real dollar method will be used in next section.

### III.2. Sensitivity analysis

[23], [19], [9], [6], and [21] all state that LCOE for all technologies has always been affected by various inputs such plant cost, O&M cost and fuel cost. When all these components are kept constant, LCOE could be sensitive to the changes of capacity factor or discount rate. Therefore, this point aimed at demonstrating the impact of the variation of capacity factor and discount rates over the LCOE for all generating technologies

## IV. Results

In this section data will be presented as calculated through different equations and, they will be analysed. We used secondary data from [23], [7], and [35]. The reason for using secondary data since industry specific data are always hard for outsiders to obtain. This section develops three levels of cost comparison. The first section attempts to analyse the costs of building power plants, costs of producing electricity among power generating technologies. Lastly the results are tested by a sensitivity analysis to discount rate variation and sensitivity analysis to load factor variation.

### IV.1. Investment costs and electricity generating costs

Table 1: capital investment costs and electricity generating costs

	Coal	Gas	Nuclear	Wind	CSP	Solar PV	Sources
<b>Capital cost</b>							
Plant cost, <i>USD/kW</i> )	3 000	800	5 400	3 100	10 300	4 100	Lazard [23]
Rated capacity, MW net	4 500	115	1 600	100	125	0.005	DoE; [7]; Lazard, [23]
Lifespan, years	40	20	40	20	35	20	Lazard, [23]
Real Discount rate, %	8.8	8.8	8.8	8.8	8.8	8.8	(Eskom, 2015)
Capital Recovery Factor, %	9.11	10.79	9.11	10.79	9.28	10.79	Equation (2)
Capacity factor, %	85	10	92	30	42.80	25	DoE [7]
Annual operating hours	8 760	8 760	8 760	8 760	8 760	8760	DoE, [7]; Lazard, [23]
Annual electricity produce, MWh	33 507 000	100 740	12 894 720	262 800	468 660	10.95	Equation (3)
Capital cost, <i>ZAR/MWh</i>	<b>533.31</b>	<b>1 431.76</b>	<b>886.92</b>	<b>1 849.36</b>	<b>3 704.27</b>	<b>2 935.12</b>	Equation (1)
<b>O&amp;M cost</b>							

Fixed cost, USD/kW	40	5	135	60	115	17.50	Lazard [35]
Variable cost, USD/MWh	2	4.70	0.50	13	-	-	Lazard [35]
O&M cost, ZAR/MWh	<b>107.11</b>	<b>151.22</b>	<b>250.65</b>	<b>520.62</b>	<b>445.67</b>	<b>116.10</b>	Equation (4)
<b>Fuel cost</b>							
Fuel price, ZAR/MMBtu	26.39	73.91	10.56	-	-	-	DoE, [7]; [35]
Heat rate, Btu/kWh	8 750	10 300	10 450	-	-	-	Lazard [23]
Fuel cost, ZAR/MWh	<b>230.91</b>	<b>761.27</b>	<b>110.35</b>	-	-	-	Equation (5)
<b>Official exchange rate 2016</b>							
ZAR/USD	14.53	14.53	14.53	14.53	14.53	14.53	World Bank [34]
<b>Cost of electricity</b>							
<b>LCOE, ZAR/MWh</b>	<b>871</b>	<b>2 344</b>	<b>1 248</b>	<b>2 370</b>	<b>4 150</b>	<b>3 051</b>	Equation (6)

The table 1 above illustrates that capital cost varies widely depending upon the technology. Of conventional technologies including coal, gas, and nuclear; gas technology has the lowest plant cost. The reason may be because gas technology is modular in nature with many of its components brought to site ready-constructed. In contrast, coal and nuclear technologies are expensive because both technologies are always constructed at the site, which requires important material and significant labor cost. The figure also shows that renewable technologies are more expensive to install. This may be since renewable energy sources are not cost competitive with conventional generating technologies. Another reason relates to the extent to which the unit should be imported. For example, CSP and Solar PV are specialized high technology machines, which are not manufactured by many firms across the world. That is why, electricity utility industries within many countries across the world purchase the equipment from abroad. This process necessitates the availability of foreign currency with which to pay for the transaction and this affects the total cost. In some circumstances this can also prevent this type of electricity generation technology to be made online if the necessary foreign currency is not available.

It can also be depicted from the table 1 above that electricity generating costs depends on the technology, and is mostly influenced by the capital investment costs. For example, of fossil fuels sources, a coal supercritical power plant will generate electricity at ZAR 871/MWh, which is significantly cheaper than either gas (ZAR 2 344/MWh). This may be due to the abundant availability of coal in South Africa. Among conventional generating technologies, nuclear may be a viable option as it does not generate greenhouse gas emission into the environment. However, the issue with nuclear is that it does not ensure safety to the environment. For instance, the Chernobyl that is considered as the major disaster that occurred at the nuclear reactor in Ukraine in 1986. The environment was seriously polluted by the plumes of radionuclides, and this caused serious damages to human health and the environment. Furthermore, nuclear waste that is radioactive and hazardous to human health can last for many decades. Of the renewable technologies, the cheapest alternative is wind with a LCOE of ZAR 2 370/MWh, followed by solar PV that has a LCOE of ZAR 3 051 /MWh. Solar PV, however, is the most expensive renewable technology option with a LCOE of ZAR 4 150/MWh. When comparing conventional technologies including coal, nuclear and gas against renewable technologies including Wind, CSP, and Solar PV, the latter ones are more expensive. One possible explanation is that renewable energy sources offer a sustainable solution in a long term since they are inexhaustible. Secondly, they guarantee safety to the environment, and lastly renewable energy sources do not produce greenhouse gases emissions into the environment like fossil fuels technologies such as coal or natural gas.

#### IV.2. LCOE sensitivity analysis to discount rate variation

the results regarding the LCOE sensitivity analysis to discount rate variation ranging from 1-20% can be observed from the table 1 below:

Table 2: LCOE sensitivity analysis to discount rate variation

Electricity Generating Plants (LCOE, ZAR/MWh)
---



Discount rate (%)	Coal		Gas		Nuclear		Wind		CSP		Solar PV	
	CRF (%)	LCOE (ZAR/MWh)	CRF (%)	LCOE (ZAR/MWh)	CRF (%)	LCOE (ZAR/MWh)	CRF (%)	LCOE (ZAR/MWh)	CRF (%)	LCOE (ZAR/MWh)	CRF (%)	LCOE (ZAR/MWh)
1	3.02	515	5.54	1 648	3.02	655	5.54	1 470	3.38	1 795	5.54	1 623
2	3.65	552	6.11	1 723	3.65	716	6.11	1 568	3.99	2 038	6.11	1 778
3	4.32	591	6.71	1 803	4.32	781	6.71	1 671	4.65	2 302	6.71	1 941
4	5.05	634	7.35	1 888	5.05	853	7.35	1 780	5.35	2 581	7.35	1 999
5	5.82	679	8.02	1 977	5.82	928	8.02	1 895	6.10	2 880	8.02	2 298
6	6.64	727	8.71	2 068	6.64	1 007	8.71	2 013	6.89	3 196	8.71	2 485
7	7.5	777	9.43	2 164	7.5	1 091	9.43	2 137	7.72	3 527	9.43	2 681
8	8.38	828	10.18	2 263	8.38	1 177	10.18	2 265	8.58	3 870	10.18	2 885
9	9.29	882	10.95	2 365	9.29	1 265	10.95	2 397	9.46	4 222	10.95	3 095
10	10.22	936	11.74	2 470	10.22	1 356	11.74	2 538	10.36	4 581	11.74	3 310
11	11.17	992	12.55	2 578	11.17	1 448	12.55	2 672	11.29	4 952	12.55	3 530
12	12.13	1 048	13.38	2 688	12.13	1 542	13.38	2 814	12.23	5 327	13.38	3 756
13	13.09	1 104	14.23	2 801	13.09	1 635	14.23	2 959	13.18	5 707	14.23	3 987
14	14.07	1 162	15.09	2 915	14.07	1 731	15.09	3 107	14.14	6 090	15.09	4 221
15	15.05	1 219	15.97	3 032	15.05	1 826	15.97	3 258	15.11	6 477	15.97	4 460
16	16.04	1 277	16.86	3 150	16.04	1 923	16.86	3 410	16.08	6 864	16.86	4 702
17	17.03	1 335	17.76	3 269	17.03	2 019	17.76	3 565	17.07	7 259	17.76	4 947
18	18.02	1 393	18.68	3 391	18.02	2 115	18.68	3 722	18.05	7 651	18.68	5 197
19	19.01	1 451	19.60	3 513	19.01	2 212	19.60	3 880	19.04	8 046	19.60	5 448
20	20.01	1 509	20.53	3 637	20.01	2 309	20.53	4 039	20.03	8 441	20.53	5 701

From the table 2 above, it can be observed that the growth of discount rate increases the LCOE for all generating technologies. Among all generating technologies, it can be noticed that coal is the cheapest option regardless of the growth of discount rate. Of conventional technologies including coal, gas, and nuclear, it can be observed that nuclear technology is very sensitive to the changes of discount rate than any other conventional technology. The reason may be because nuclear has got higher investment cost and longer construction time than coal and gas technologies. Of renewable energy including wind, CSP, and solar PV, it can be observed that wind is less sensitive to discount rate changes while CSP is very sensitive regardless of the discount rate variation. One possible explanation is that wind has got lower investment cost and shorter construction time than CSP. Of renewable technologies, it can also be noticed that the ranking order does not change between wind and CSP. The reason may be since CSP has a higher investment cost and a higher construction time than wind technology. In conclusion, it can be observed that of all generating technologies, gas is the least sensitive as the discount rate changes. The reason is due to investment cost of gas that is lower than for any other technology.

### IV.3. LCOE Sensitivity analysis to load factor variation

The capacity factor of an electricity generation plant shows the amount of the electricity generated by power plant. The capacity factor is an important key for the economics of the power plant, because it shows the magnitude of electrical energy generated per unit of producing capacity, which will yield returns to cover the initial capital investment and the operating costs of the power plant. Sensitivity analysis to capacity factor changes was performed to test the sensitivity of cost of electricity generation for various generating technologies. Figure 1 shows the evolution in the LCOE as a function of capacity factor changes at the real discount rates used in this study.

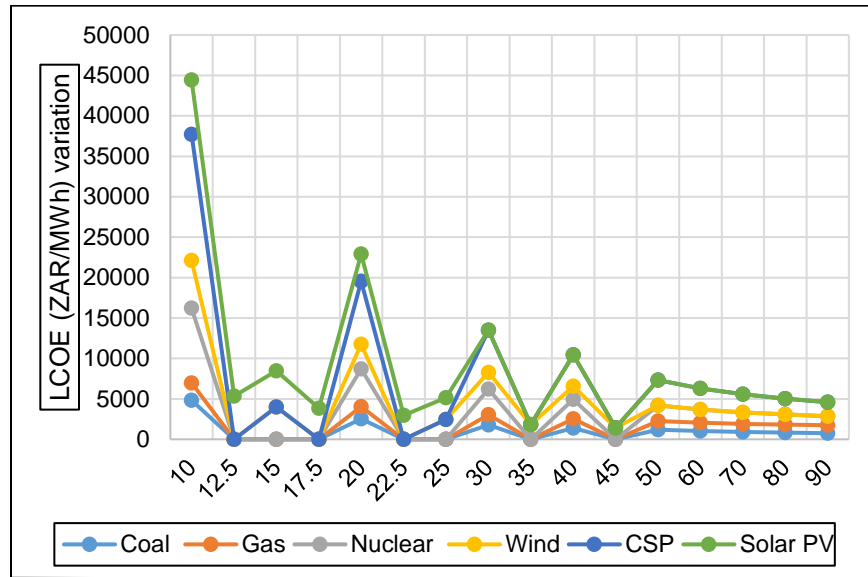


Figure 1. LCOE sensitivity analysis to capacity factor

The first observation from the figure 1 above, is that the change in load factor influence considerably the plants that have high fixed costs. For example, it can be observed that of conventional technologies including coal, gas, and nuclear, the LCOE of coal and nuclear technologies is more affected by the load factor variation. One possible explanation is that coal and nuclear technologies have higher fixed cost than gas technology. It can also be observed from renewable energy sources including, wind, CSP, and solar PV that the variation of load factor affects them seriously. The reason is that the fixed costs of renewable energy sources constitute a significant share of total costs. Among all generating technologies, gas is the least sensitive to the capacity factor variation. One explanation is that variable costs of gas technology weigh most in total cost than fixed cost.

#### IV.4. LCOE sensitivity analysis to lifetime

The projected economic lifespan of operation varies between generating technologies. The general study assumptions hold that coal and nuclear plants last up to 40 years. While gas, wind, and solar PV power plants around 20 years, CSP 35 years. The sensitivity analysis tests were conducted by changing the lifetimes from 20 to 60 years. The results of the sensitivity analysis are summarized in Figure 2. On the vertical axis, 100% corresponds to the LCOE in accordance with lifetime variation

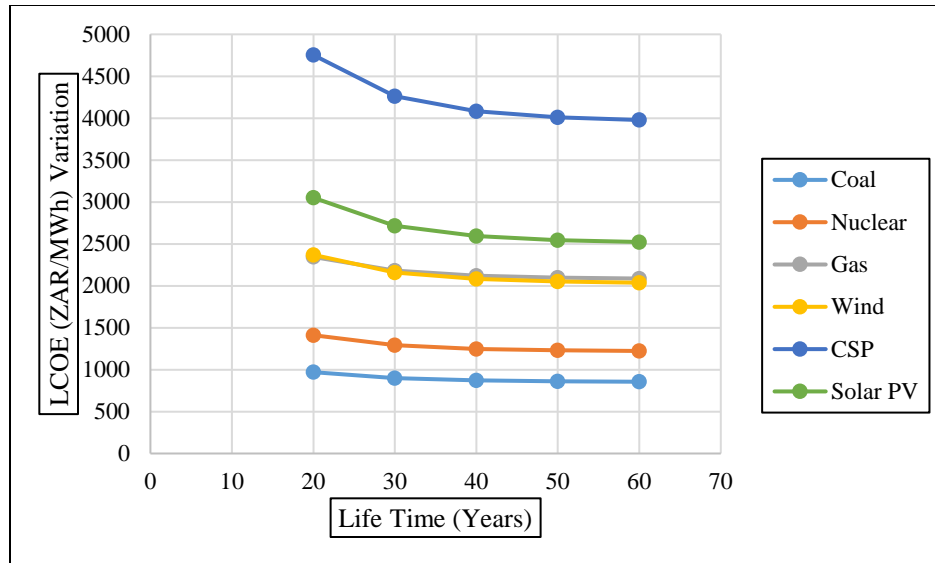


Figure 2: LCOE sensitivity analysis to lifetime

The most significant conclusion which can be drawn from this analysis is the noticeable asymmetric effect on LCOE of early retirement of plants when comparing to lifespan extensions at the real discount rate used in this study. Although early retirement considerably rises the LCOE, lifespan extensions do not have significant impact on LCOE. This is real for all generating technologies, even though the impact is more obvious for those powers generating plants that have shorter operating lifespans. As soon as the plant has been commissioned, and much of the investment cost has been acquired, an early retirement of the plant considerably influences its capability of recovering the initial capital investment. In contrast, in the case of lifespan extensions, when the plant has already paid back the initial capital investment during the expected payback period, additional extensions will logically produce extra returns for the plant; but, because of the discounting consequence, incomes accumulating far ahead in the future do not have much impact on LCOE after being discounted. Also because of the discounting consequence, power generating plants with longer lifespans are not much affected by relative changes in the operating lifespan of the plant. For instance, despite its high up-front costs, which must be paid back with the incomes generated during the entire lifespan, any extension of the lifespan of a nuclear power plant beyond 40 years has very little effect on the LCOE after costs and returns for the expected period are discounted. Beyond 40 years, which is the operating lifespan expected for coal plants, any change of this parameter does not have much effect on the LCOE. On the other hand, LCOE produced by gas, wind, and solar PV, with shorter lifespans, are the most affected by the change in the lifespan of the plant. The least affected technology is CSP, with an initial lifetime of 35.

## V. Conclusion

To facilitate informed decision making in South African electricity sector for an optimum funding allocation between the construction of conventional generating technologies and renewable energy sources. The study aimed at comparing the costs producing electricity through new build power plants. The results revealed that renewable energy technologies have the highest costs than other generating technologies. At this level, it was concluded that although renewable technologies are expensive than fossil fuels sources and nuclear technology, they should be given more weight since they are inexhaustible, secondly, they guarantee safety to the environment, and thirdly they do not generate greenhouse gas emission into the environment.

## References

- [1] Black & Veatch "Levelized Cost of Energy Calculation. Energy Foundation - The China Sustainable Energy Program Notes", 2011, Pilot project to generate electricity from the ocean of the Durban coastline [Online]. UrbanEarth. Available: <http://urbanearth.co.za/articles/pilot-project-generate-electricity-ocean-durban-coastline>. [Accessed 20 Nov 2014].

- [2] Branker K., Pathak M., Pearce J. "A Review of Solar Photo-voltaic Levelized Cost of Electricity", 2001, *Renewable & Sustainable Energy Reviews* 15, 4470-4482. <http://dx.doi.org/10.1016/j.rser.2011.07.104>
- [3] Burnard, K. & Bhattacharya, S "Power generation from coal - Ongoing Developments and Outlook", 2011, [Online]. Paris: International Energy Agency. Available: [www.iea.org/publications/freepublications/publication/power\\_generation\\_from\\_coal-1.pdf](http://www.iea.org/publications/freepublications/publication/power_generation_from_coal-1.pdf) [Accessed 10 Feb 2015].
- [4] Carlo M "the costs of generating electricity and the competitiveness of nuclear power Progress in Nuclear Energy", 2014, 73, 153- 161
- [5] Daniel G., Prasanta K., John G "A fuzzy levelised energy cost method for renewable energy technology assessment", 2013, *Energy Policy* 62, 315–323. Available online at [www.sciencedirect.com](http://www.sciencedirect.com)
- [6] DECC "Electricity generation costs", 2013, Available online from ([http://www.decc.gov.uk/en/content/cms/about/ec\\_social\\_res/analytic\\_projs/gen\\_costs/gen\\_costs.aspx](http://www.decc.gov.uk/en/content/cms/about/ec_social_res/analytic_projs/gen_costs/gen_costs.aspx))
- [7] DoE "Integrated Resource Plan for Electricity 2010-2030: Update Report", 2013, Available at:[http://www.DOE-irp.co.za/content/IRP2010\\_updatea.pdf](http://www.DOE-irp.co.za/content/IRP2010_updatea.pdf).
- [8] EIA "Levelized Cost of New Generation Resources in the Annual Energy Outlook", 2015. (Available at: [http://www.eia.gov/forecasts/aeo/pdf/electricity\\_generation.pdf](http://www.eia.gov/forecasts/aeo/pdf/electricity_generation.pdf))
- [9] EPRI "Power Generation Technology Data for Integrated Resource Plan of South Africa", 2012, Palo Alto, CA.
- [10] Eskom "MEGA Tranche Residential Mass Roll Out", 2012, Available: [www.poweralert.co.za/poweralert5/index.php](http://www.poweralert.co.za/poweralert5/index.php) [Accessed 19 May 2015].
- [11] EUSUSTEL "Comprehensive Analysis of Future Euro-pean Demand and Generation of European Electricity and its Security of Supply", 2007, Final Technical Report, no. 006602. Available from [www.eusustel.be/results.php](http://www.eusustel.be/results.php).
- [12] Fluri, T "the potential of concentrating solar power in South Africa", 2009, *Energy Policy*, 37, 5075-5080
- [13] Francesco F., Oliver B., Dimitris M., Manuel W., Morgan B., Mark H "A cost comparison of technology approaches for improving access to electricity services", 2015, *Energy* 95, 255 – 265. Available from [www.sciencedirect.com](http://www.sciencedirect.com)
- [14] Griffin, J. "A smart energy policy : an economist's Rx for balancing cheap, clean, and secure energy", 2009, New Ha-ven, Yale University Press.
- [15] Gross, R., Heptonstall, P., Blyth, W "Investment in Electricity Generation: the Role of Costs, Incentives and Risks", 2007, UKERC, London.
- [16] Guzmán D., Javier G. & José C "Dynamic evaluation of the levelized cost of wind power generation, Energy Conversion and Management", 2015, 101, 721–729. Available online at [www.sciencedirect.com](http://www.sciencedirect.com)
- [17] Hisham, K " A review of the IEA/NEA Projected Costs of Electricity", 2015, edition, *Energy Policy* 88, 229–233. Available online at [www.sciencedirect.com](http://www.sciencedirect.com)
- [18] IEA "World energy statistics. IEA World Energy Statistics and Balances.in Iran: Achievement and Challenges", 2012, *The Electricity Journal*, 22, 74-83.
- [19] IEA/NEA "Projected Costs of Generating Electricity", 2010, International Energy Agency/Nuclear Energy Agency/Organisation for Economic Co-operation and Development, Paris.

- [20] Jason W "A Comparative Analysis of the Future Cost of Electricity Generation in OECD and Non-OECD Countries", 2011, Vol. 25, Issue 1040-6190 doi:/10.1016/j.tej.2011.12.003. Available from [www.sciencedirect.com](http://www.sciencedirect.com)
- [21] Khatib, H. "Economic Evaluation of Projects in the Electricity Supply Industry", 2014, 3rd Edition. The Institution of Engineering and Technology, London, UK.
- [22] Klein, J. "Comparative Costs of California Central Station Electricity Generation Technologies", 2009, California Energy Commission, CEC-200-2009-017-SD.
- [23] Lazard "Levelized Cost of Energy Analysis- Version 9", 2016, Available at [https://www.lazard.com/.../levelized\\_cost\\_of\\_energy\\_-\\_version\\_9.pdf](https://www.lazard.com/.../levelized_cost_of_energy_-_version_9.pdf) [Accessed 26 Mar 2016].
- [24] Leland, B & Anthony, T "Engineering economy", 2012, 7th ed, 1221 Avenue of the Americas, New York, McGraw-Hill.
- [25] McGreal, C "Mines shut as South Africa faces electricity emergency", 2008, [Online]. Available: [www.guardian.co.uk/world/2008/jan/25/southafrica.business](http://www.guardian.co.uk/world/2008/jan/25/southafrica.business) [Accessed 21 Mar 2015].
- [26] Mulongo, N.Y, Marnewick A; and Daniel "Cost analysis: power generation plants versus demand side management programmes", 2016, Master Thesis, Faculty of Engineering and the Built Environment, University of Johannesburg.
- [27] NREL "Simple Levelized Cost of Energy (LCOE) Calculator Documentation", 2010, [Online]. Available: [www.nrel.gov/analysis/lcoe\\_documentation.html](http://www.nrel.gov/analysis/lcoe_documentation.html) [Accessed 14 Mar 2015].
- [28] Parrado, C., Girard, A., Simon, F., Fuentealba, E. "2050 LCOE (Levelized Cost of Energy) projection for a hybrid PV (photovoltaic)-CSP (concentrated solar power) plant in the Atacama Desert, Chile", 2015, Energy, 94, 422- 430. Available online at [www.sciencedirect.com](http://www.sciencedirect.com)
- [29] Paul B "The Cost of Power Generation the current and future competitiveness of renewable and traditional technologies", 2010, Management Report published by Business Insights.
- [30] Roth, F. & Ambs, L "Incorporating externalities into a full cost approach to electric power generation life-cycle costing", 2004, Energy, 29, 2125-2144.
- [31] Simon L., Dean F., Simon D., Sven K., Mikael H. "Re-viewing electricity production cost assessments", 2013, Renewable and Sustainable Energy Reviews 30, 170–183. Available online at [www.sciencedirect.com](http://www.sciencedirect.com).
- [32] Umberto D., Pietro E. "Analysis and comparison between a concentrating solar and a photovoltaic power plant", 2014, Applied Energy 113, 422–433. Available from [www.sciencedirect.com](http://www.sciencedirect.com)
- [33] WEC "Cost of Energy Technologies", 2013. Available from <https://www.worldenergy.org/.../2013/world-energy-perspective-cost-of> [Accessed 15 May 2015].
- [34] World Bank "Global Economic Monitor", 2015. Available at [www.databank.worldbank.org/data/reports.aspx?...global-economic-monitor](http://www.databank.worldbank.org/data/reports.aspx?...global-economic-monitor) [Accessed 25 Nov 2015].
- [35] WWF-SA. "Feasibility of the WWF Renewable Energy Vision 2030 – South Africa: A spatial-temporal analysis of the WWF Renewable Energy Vision 2030", 2015, South Africa. Available at [wwf.panda.org](http://wwf.panda.org).
- [36] Zhao Z., Da Zhang., Peggy M., Xiliang Z. "Electricity generation costs of concentrated solar power technologies in China based on operational plants", 2015, Energy 89, 65-74. Available from [www.sciencedirect.com](http://www.sciencedirect.com)
- [37] Amusa H., Amusa, K. & Mabugu, R. 2009. Aggregate demand for electricity in South Africa: An analysis using the bounds testing approach to co-integration. Energy Policy, 37, 4167-4175.

- [38] Balat, M. 2010. Security of energy supply in Turkey: Challenges and Solutions. *Energy Conversion and Management*, 51, 1998-2011.
- [39] Billinton, R., Tollefson, G. & Wacker, G. 1993. Assessment of electric service reliability worth. *International Journal of Electrical Power & Energy Systems*, 15, 95- 100.
- [40] Costantini, V., Graceva, F., Markandya, A. & Vicini, G. 2007. Security of energy supply: Comparing scenarios from a European perspective. *Energy Policy*, 35, 210-226. Available online at [www.sciencedirect.com](http://www.sciencedirect.com)
- [41] Damigos, D., Tourkolias, C. & Diakoulaki, D. 2009. Households' willingness to pay for safeguarding security of natural gas supply in electricity generation. *Energy Policy*, 37, 2008-2017. Available online from [www.sciencedirect.com](http://www.sciencedirect.com)
- [42] De Nooij, M., Koopmans, C. & Bijvoet, C. 2007. The value of supply security: The Costs of power interruptions: Economic input for damage reduction and investment in networks. *Energy Economics*, 29, 277-295. Designated National Authority
- [43] DoE. 2010. Integrated Resource Plan [Online]. Department of Energy. Available: [www.energy.gov.za/files/irp\\_frame.html](http://www.energy.gov.za/files/irp_frame.html) [Accessed 21 Mar 2015].
- [44] Eberhard, A. 2002. The Political, Economic, Institutional and Legal Dimensions of Electricity Supply Industry Reform in South Africa. Political Economy of Power Market Reform Conference. Stanford University: Program on Energy and Sustainable Development.
- [45] Egenhofer, C. 2004. Integrating Security of Supply, Market Liberalisation and Climate Change. The European Commission's Green Paper on Secure, Competitive and Sustainable Energy for Europe from a security-of-supply perspective.
- [46] Eskom. 2014. Annual report on transmission development plan. Available on [www.eskom.co.za](http://www.eskom.co.za)
- [47] Eskom. 2013. South Africa National Power Usage and Forecast [Online]. Available: [www.poweralert.co.za/poweralert5/index.php](http://www.poweralert.co.za/poweralert5/index.php) [Accessed 19 May 2015].
- [48] IEA .2001. Energy Policies of IEA Countries: Norway 2001 Review. In: AGENCY, I. E. (ed.) IEA Publications. France.
- [49] IEA 2005. Energy Policies of IEA Countries: Norway 2005 Review. In: AGENCY, I. E. (ed.) IEA Publications. France.
- [50] IEA. 2012. World energy statistics. IEA World Energy Statistics and Balances. in Iran: Achievement and Challenges. *The Electricity Journal*, 22, 74-83.
- [51] Inglesi-Lotz, R. & Blignaut, J. 2011. South Africa's Electricity Consumption: A Sectorial Decomposition Analysis. Working Paper 203. Pretoria: University of Pretoria.
- [52] Khosroshari, K., Jadid, S. & Shahidehour, M. 2009. Electric Power Restructure
- [53] Lazenby, H. 2011. Power supply crisis may lead to demand crisis [Online]. *Engineering News* Available: [www.engineeringnews.co.za/article/power-supply-crisis-may-lead-to-demand-crisis-2011-10-26](http://www.engineeringnews.co.za/article/power-supply-crisis-may-lead-to-demand-crisis-2011-10-26) [Accessed 12 Apr 2015].
- [54] Leonardo. 2009. Electric Load Management in Industry. An international report for International Union for Electroheat (UIE). Available online from <http://www.leonardo-energy.org> [Accessed 07 Feb 2015].
- [55] Ziramba, E. 2008. The demand for residential electricity in South Africa. *Energy Policy*, 36, 3460-3466.

## **Biography**

**Ndala Yves Mulongo** is currently conducting a PhD degree in Quality and Operations Management, Faculty of Engineering and the built environment, University of Johannesburg. He holds bachelor of engineering in extraction metallurgy and master of engineering in engineering management from University of Johannesburg, South Africa. His research interests involve cost of electricity production, energy efficiency measures, green supply chain management, impact of mining operations on environment, mineral processing, manufacturing processes.

**Dr Pule Kholopane** is currently a Senior Lecturer and Head of Department in the Department of Quality and Operations Management, Faculty of Engineering and the Built Environment, University of Johannesburg, South Africa. He has both industrial and academic experience for more than twenty years. He has got a Doctorate of Engineering degree from the University of Johannesburg where he has been supervising masters and PhD students during the current decade. He has published several journal and conference research papers. His research areas include project management, process optimizations, manufacturing processes, supply chain management, sustainability, production planning, energy efficiency, waste reduction, product development and marketing, product quality related issues, cost analysis, etc.